
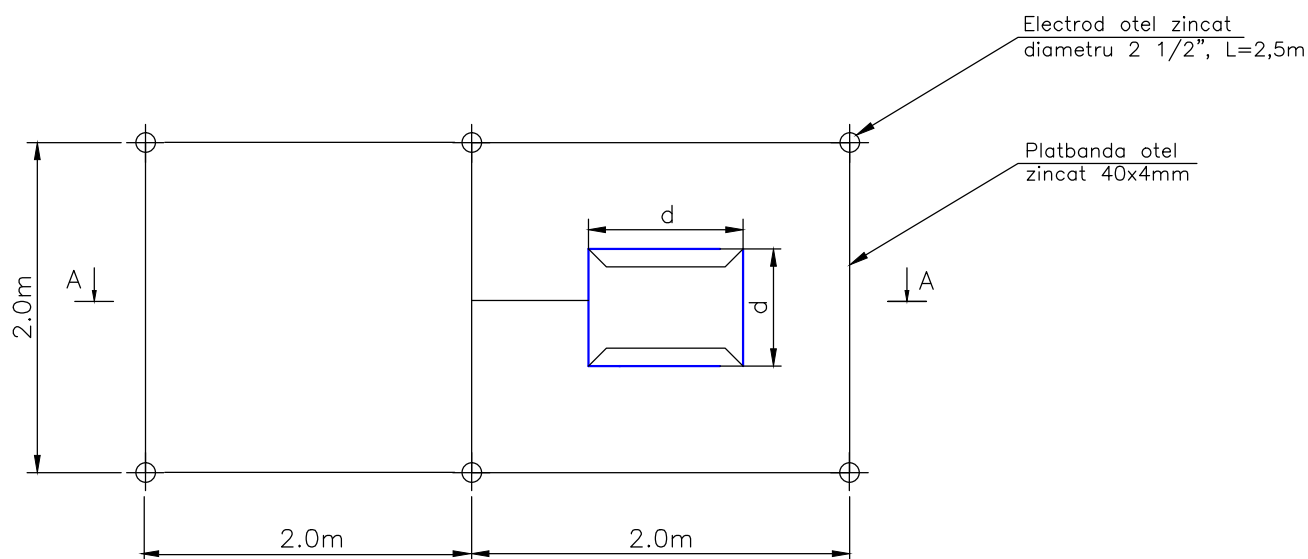



A — A

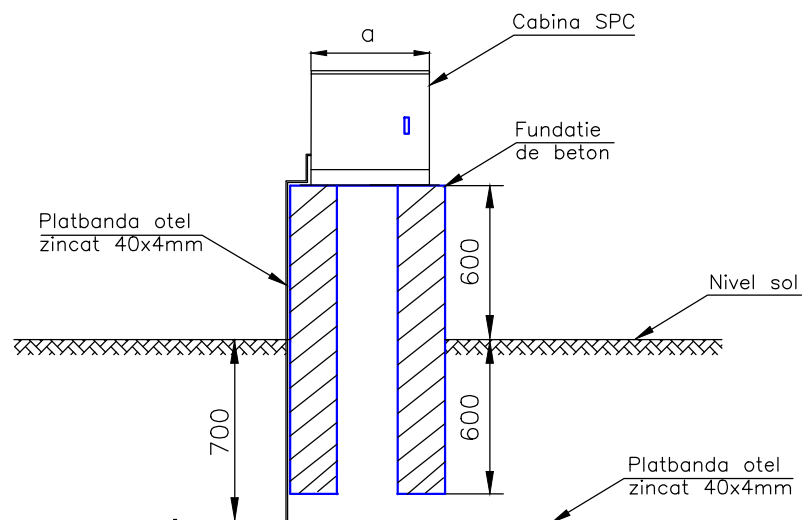

Nota:

- Platbanda de otel zincat si electrozii de otel zincat se vor ingropa la adancimea de 0.7m;
- Daca nu se realizeaza rezistenta de dispersie de max. 4 ohmi se vor mai adauga electrozi de otel zincat pana se obtine valoarea de maxim 4 ohmi;
- Dimensiunile cabinei sunt functie de producator si nu se cunosc.

		08.06.2019	STEFANICA OANA	STEFANICA VICTOR	STEFANICA VICTOR
REV.	DESCRIERE	DATA	PROIECTAT	VERIFICAT	APROBAT
S.C.CONPET S.A. STR. 1848, NR. 1 - 3 PLOIESTI, ROMANIA 	DENUMIRE PROIECT: Constructie rezervor nou pentru titei (V=2500 mc) Statia de Pompare Biled				
	DENUMIRE DESEN: Legare la pamant Cabina SPC				
	NUMAR DESEN.:	PC-08			SCARA:
	FISIER:	PC08-DWG			FILA: 1/1