

12345678

A

B

C

D

E

F

12345678

A

B

C


D

E


F

# Cutie contori - PT 20/0.4 kV

Contor mator Trafo 0.4 kV

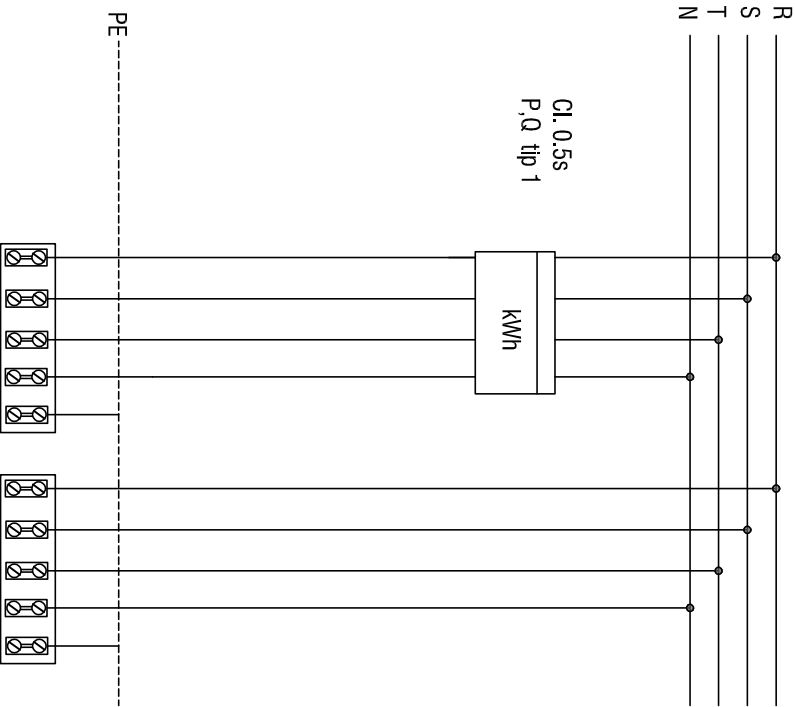

Tablou PSI

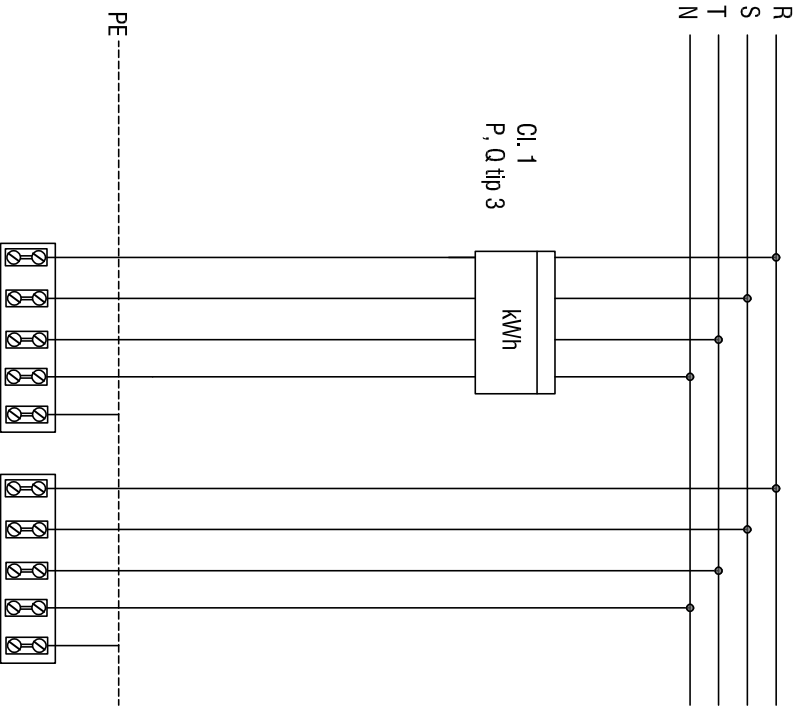

Consumator	Curent	Teninue
Pi [kW]	250	
I <sub>c</sub> [A]	1	400
s <sub>c</sub> [mmp]	C2XY-F 1kV 4x6mmp	C2XY-F 1kV 4x6mmp

Consumator	Curent	Tensiune
Pi [kW]	240	
I <sub>c</sub> [A] /U [V]	1	400
s <sub>c</sub> [mmp]	C2XY-F 1kV 4x6mmp	C2XY-F 1kV 4x6mmp

Beneficiar:

S.C. CONPET S.A.

Obiectiv:

Sistem de teletransmisie si telegestione a consumului de e.e. in localite CONPET

Proiectat

ing. Liliana Spataru

Contract: 182/0010/10.04.2018

Verificat

ing. Ioan Vasiliu

Borderou: 0010/I.5.4-DE-00000

Aprobat

Ing. Iulian Pavaloaia

Data:09.2018

Denumire plan:

Schema electrica monofilara dulap tip 2 (PT 20/0,4 kV) - Rampa Ciresu

Proiectant:

Energy Design & Consulting

Scara: %

Cod plan:

0010/I.5.4-DE-23129

Rev: 0

Nr.pag: 1

Forma: A3

Beneficiar:

S.C. CONPET S.A.

Obiectiv:

Sistem de teletransmisie si telegestione a consumului de e.e. in localite CONPET

Proiectat

ing. Liliana Spataru

Contract: 182/0010/10.04.2018

Verificat

ing. Ioan Vasiliu

Borderou: 0010/I.5.4-DE-00000

Aprobat

Ing. Iulian Pavaloaia

Data:09.2018

Denumire plan:

Schema electrica monofilara dulap tip 2 (PT 20/0,4 kV) - Rampa Ciresu

Proiectant:

Energy Design & Consulting

Scara: %

Cod plan:

0010/I.5.4-DE-23129

Rev: 0

Nr.pag: 1

Forma: A3

Beneficiar:

S.C. CONPET S.A.

Obiectiv:

Sistem de teletransmisie si telegestione a consumului de e.e. in localite CONPET

Proiectat

ing. Liliana Spataru

Contract: 182/0010/10.04.2018

Verificat

ing. Ioan Vasiliu

Borderou: 0010/I.5.4-DE-00000

Aprobat

Ing. Iulian Pavaloaia

Data:09.2018

Denumire plan:

Schema electrica monofilara dulap tip 2 (PT 20/0,4 kV) - Rampa Ciresu

Proiectant:

Energy Design & Consulting

Scara: %

Cod plan:

0010/I.5.4-DE-23129

Rev: 0

Nr.pag: 1

Forma: A3