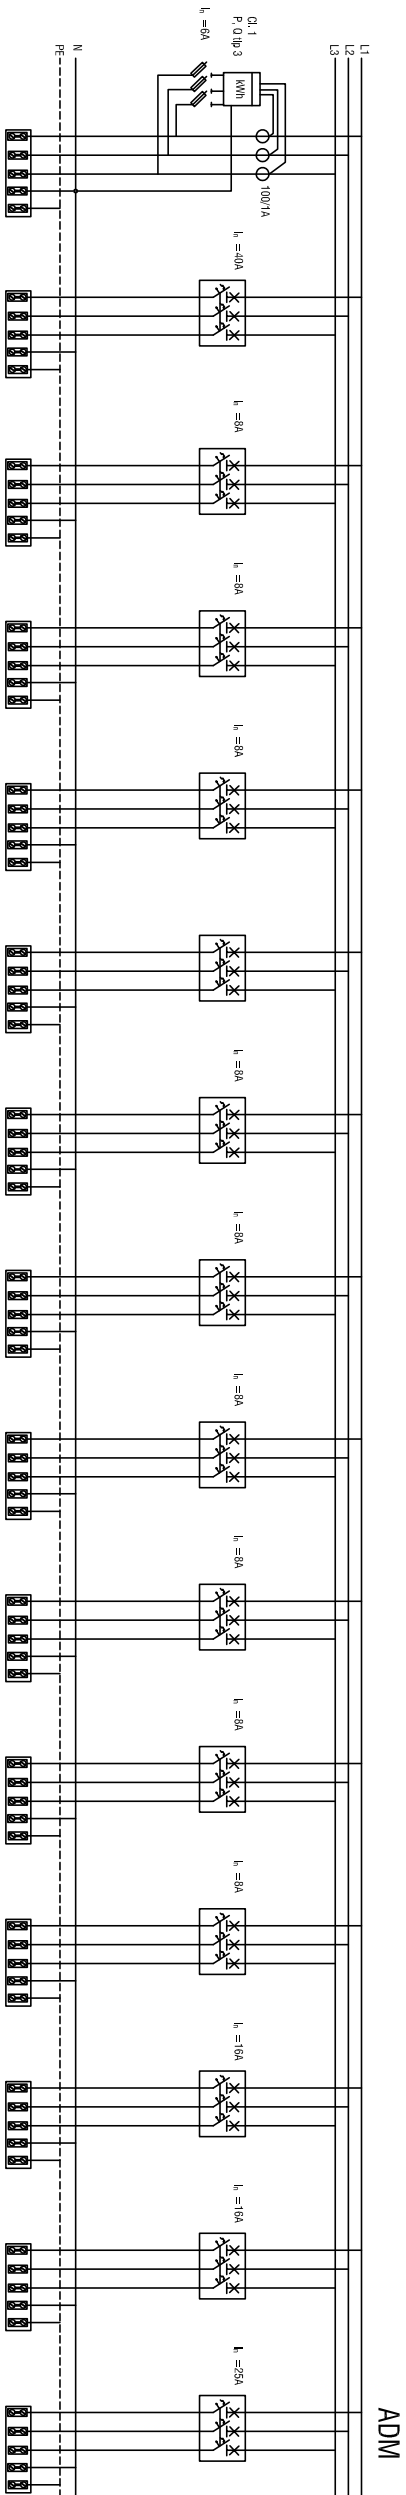
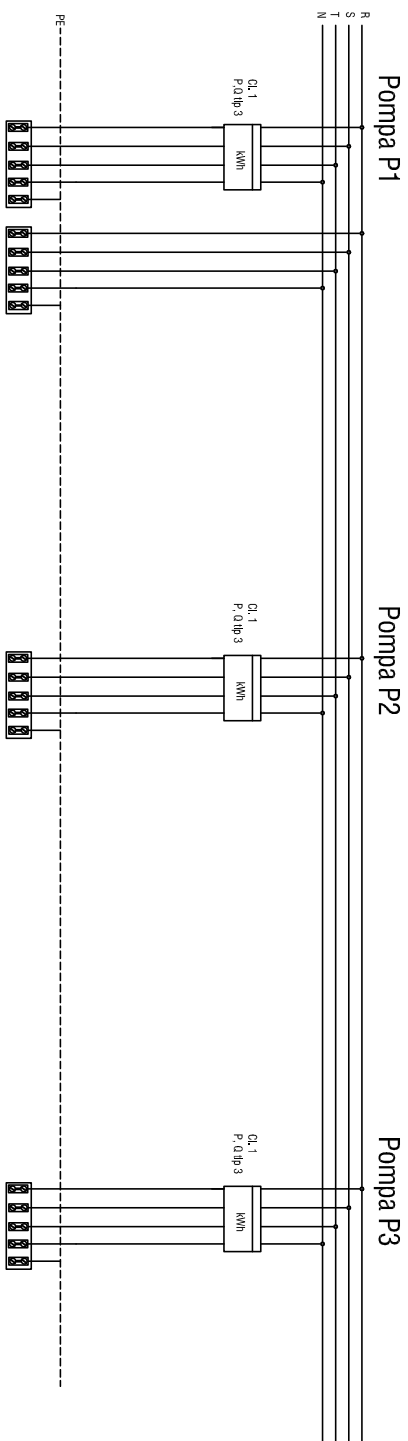


Dulap contori - Rampa Ciresu

[illegible]

| Consumator | Curent | Tensiuine |
|-------------------------|---------------------|---------------------|
| Pi [kW] | 75 | |
| I _L [A] U[V] | 400 | |
| s _d [mm] | C2XY-F 1kV 4x6mm | C2XY-F 1kV 4x6mm |

| | |
|----------------------|----------------------------------|
| Consumer | Current |
| Pi [kW] | 75 |
| Ic[A] | 1 |
| sc[mm ²] | C2XY-F 1kV 4x6mm ² |

| | |
|----------------------|----------------------------------|
| Consumer | Current |
| Pi [kW] | 75 |
| Ic[A] | 1 |
| sc[mm ²] | C2XY-F 1kV 4x6mm ² |

| | | | |
|-----------|-----------------------|--------------------------------|--|
| Proiectat | ing. Liliانا Spataru | Contract: 162/00/07/04-04-2018 | Obiectiv: Sistem de teletransmisie si telegestiune a consumului de e.e. in localitile CONPET |
| Verificat | ing. Ioan Vasiliu | Borderou: 0010/1.5.4-DE-00000 | |
| Aprobat | ing. Iulian Pavaloala | | |
| | | Data: 09.2018 | |

Beneficiario:
S.C. CONPET S.A.

REPRODUCEREA, ÎMPRUMUTAREA SAU EXPUNEREA ACESTUI DOCUMENT, PRECUM ȘI TRANSMITEREA INFORMAȚIILOR CONȚINUTE SUNT PERMISE NUMAI CONFORM CONTRACT. UTILIZAREA
EXTRACONTRACTUALĂ NECESITĂ ACORDUL SCRIS AL **ED&C SRL**