




Dulap contori - Statia Otesi

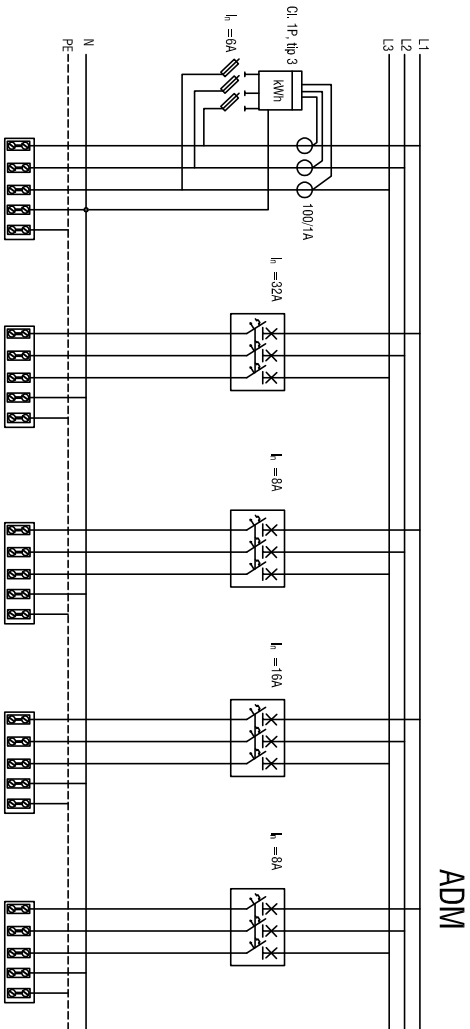

Consumator	Sosire	Tablou il. normal	Tablou punct termic	Telecom	Aer conditionat
Pi [kW]	35	15	3	5	3.7
Ic[A]	50	22	4	7	5
sc[mmp]	C2XY-F 1kV 3x25+16mmp	C2XY-F 1kV 4x10mmp	C2XY-F 1kV 4x6mmp	C2XY-F 1kV 4x6mmp	C2XY-F 1kV 4x6mmp

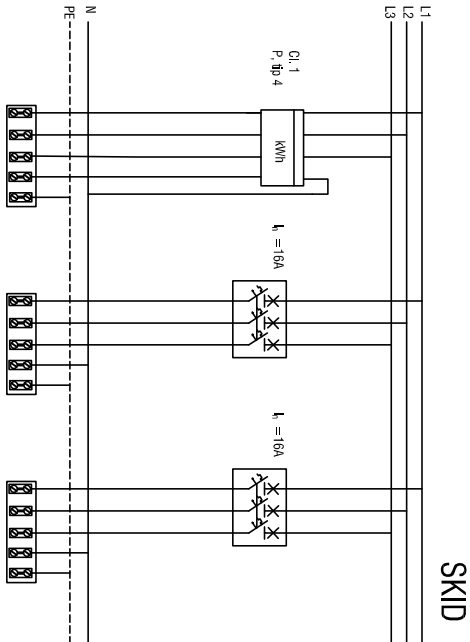

Consumator	Sosire	SKID forta	SKID Incalzire
Pi [kW]	15	7	7
Ic[A]	22	10	10
sc[mmp]	C2XY-F 1kV 4x10mmp	C2XY-F 1kV 4x6mmp	C2XY-F 1kV 4x6mmp

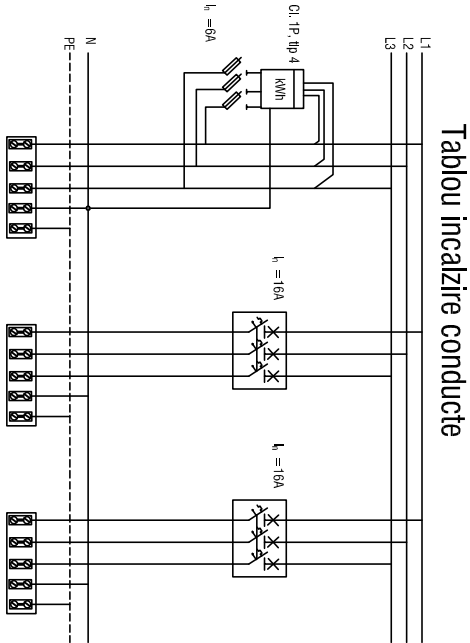

Consumator	Sosire	Incalzire TAD3C	Incalzire TAD5C
Pi [kW]	15	7	7
Ic[A]	22	10	10
sc[mmp]	C2XY-F 1kV 4x10mmp	C2XY-F 1kV 4x6mmp	C2XY-F 1kV 4x6mmp

Beneficiar:
S.C. CONPET S.A.

Obiectiv: Sistem de teletransmisie si telegestione a consumului de e.e. in localitile CONPET

Denumire plan: Schema electrica monooflilara dulap tip 1 - Statia Otesi

Proiectat	ing. Liliana Spataru	Contract: 182/0010/10.04.2018
Verificat	ing. Ioan Vasiliu	Borderou: 0010/I.5.4-DE-00000
Aprobat	Ing. Iulian Pavaloaia	Data:09.2018
Faza: DE		
Denumire plan: Schema electrica monooflilara dulap tip 1 - Statia Otesi		
Proiectant:	Energy Design & Consulting	Scara: %
Cod plan: 0010/I.5.4-DE-23164		

EDC
ENERGY DESIGN & CONSULTING
SIR, 1400 CHIA, Nr. 20/21, Sector 1,
ISO 9001
ISO 14001
J40/24-42014, CUI:33134682