




Dulap contori - Statia Calareti (Statia A)

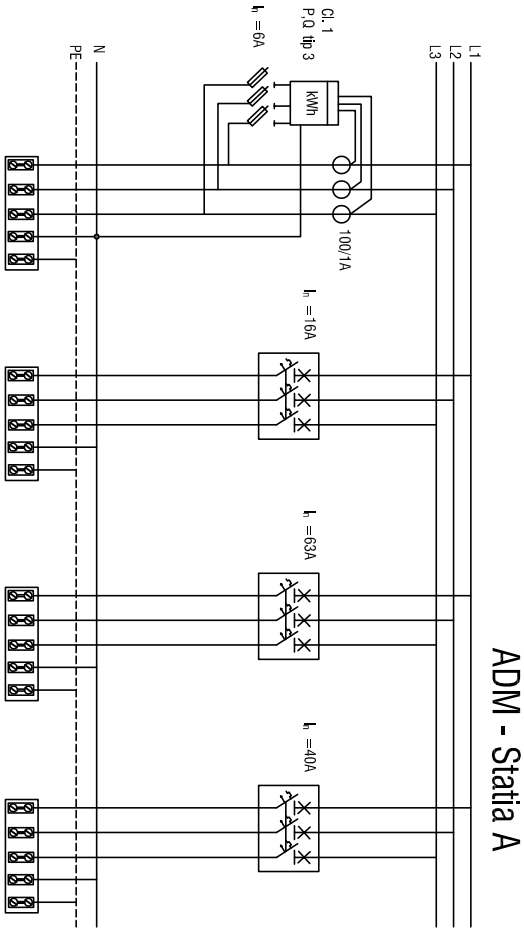

Consumator	Sosire	Dispecerat A+B	TGL 1	Telekom
Pi [kW]	50	5	24	20
Ic[A]	72	8	35	29
sc[mmp]	C2XY-F 1kV 3x25+16mmp	C2XY-F 1kV 4x6mmp	C2XY-F 1kV 4x16mmp	C2XY-F 1kV 4x10mmp

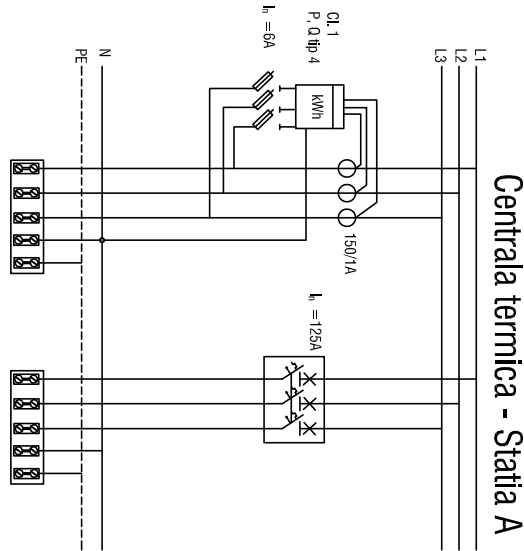

Consumator	Sosire	Plecare
Pi [kW]	60	60
Ic[A]	87	87
sc[mmp]	C2XY-F 1kV 3x35+16mmp	C2XY-F 1kV 3x35+16mmp

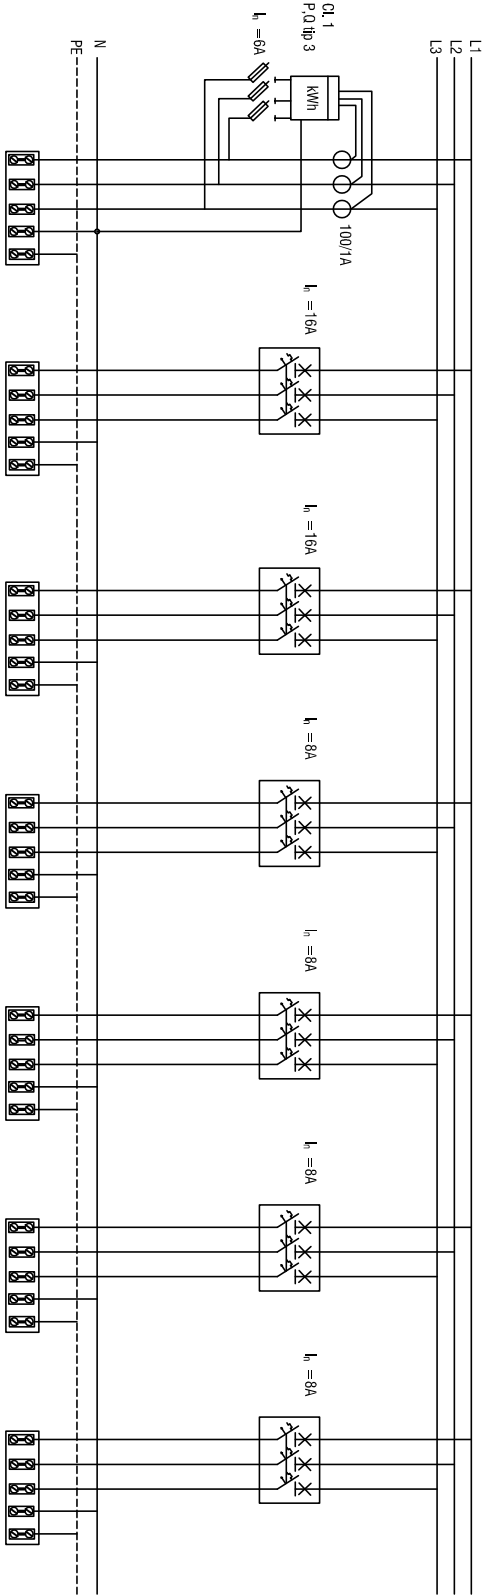

Consumator	Sosire	SKID Masura 1	SKID Masura 2	SKID 14" (D5)	SKID 14" (D6)	SKID 14" (D6)
Pi [kW]	32	9	9	4	4	4
Ic[A]	46	13	13	6	6	6
sc[mmp]	C2XY-F 1kV 3x25+16mmp	C2XY-F 1kV 4x6mmp	C2XY-F 1kV 4x6mmp	C2XY-F 1kV 4x6mmp	C2XY-F 1kV 4x6mmp	C2XY-F 1kV 4x6mmp

REPRODUCEREA, ÎMPRUMUTAREA SAU EXPUNEREA ACESTUI DOCUMENT, PRECUM ȘI TRANSMITEREA INFORMAȚIILOR CONȚINUTE SUNT PERMISE NUMAI CONFORM CONTRACT. UTILIZAREA EXTRACONTRACTUALĂ NECESITĂ ACORDUL SCRIS AL **ED&C SRL**

Proiectat	ing. Liliana Spataru	Contract: 182/0010/10.04.2018	Obiectiv:	Sistem de teletransmisie si telegestione a consumului de e.e. in localitile CONPET
Verificat	ing. Ioan Vasiliu	Borderou: 0010/I.5.4-DE-00000		
Aprobat	Ing. Iulian Pavalocia	Data:09.2018		

Beneficiar:  
S.C. CONPET S.A.

Denumirea Contract:	Faza: DE	Denumire plan:	Rev:	0	Forma:	A3
Realizare Sistem de Teletransmisie si Telegestione a Consumului de Energie Electrica in localitile CONPET		Schema electrica monofilara dulap tip 1 (Statia A) - Statia Calareti	Nr.pag:	1		
Proiectant:	Energy Design & Consulting	Scara:	%			
ANEXA SCHEMATICI ISO 9001 ISO 14001	SIR - ISO 9001 Nr. 2624 SIR - ISO 14001 Nr. 2624 J40/04-42014, CUI:33134682					